
property owner in order to ensure performance of the detail. As with any surface-mounted termination, the vertical substrate above the seal must be waterproofed and maintained by the

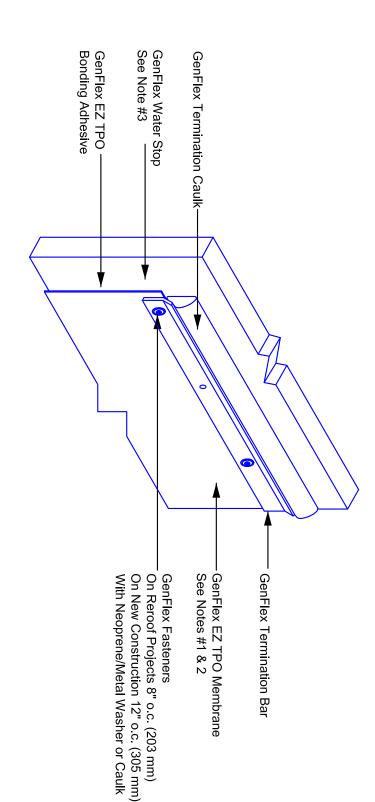

- 1. Vertical substrate must be clean and suitable for flashing.
- 2. Alternate flashing substrates may be installed over existing vertical substrates if achieved with corrosion resistant fasteners and be sufficient to resist 125 lb grade plywood and 22 ga (0.76 mm) G-90 galvanized steel. Securement must be Examples of alternate substrates are: 1/2" (13 mm) minimum thickness exterior conditions prevent the substrate from meeting GenFlex flashing requirements. (556.03 N) of pullout pressure per square foot.
- 3. For compression details that utilize GenFlex Water Stop, the substrate must be bared in the compression area down to either a masonry, or metal surface.

MAXIMUM WARRANTY: 20 Years

ISSUE / REVISION DATE: 10-26-2015

DETAIL NO.

Roofing Systems

Termination Bar

EZ TPO Systems

ACCEPTABLE SYSTEMS:

NOT TO SCALE