



NOTE:

1. REFER TO GENFLEX WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
4. PEEL & STICK PIPE FLASHING MAY BE CUT TO HEIGHT, BUT NO LOWER THAN REINFORCING RING (NO WRINKLES OR FOLDS UNDER CLAMPING RING).
5. APPLY WATERSTOP BETWEEN PENETRATION AND PRE-MOLDED PIPE FLASHING PRIOR TO INSTALLATION OF CLAMPING RING.
6. PEEL & STICK PIPE BOOT FITS 1" (25 mm) - 6" (152 mm) PENETRATION SIZES.
7. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 180 °F (82 °C). REFER TO S2S--P-4.

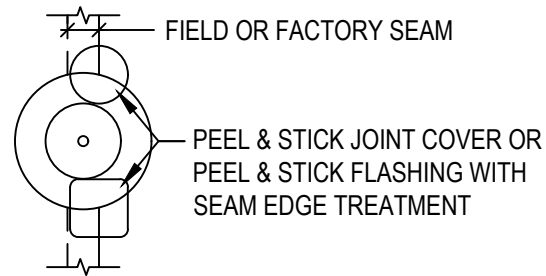

PLAN VIEW

PIPE FLASHING OVER FIELD OR FACTORY SEAM

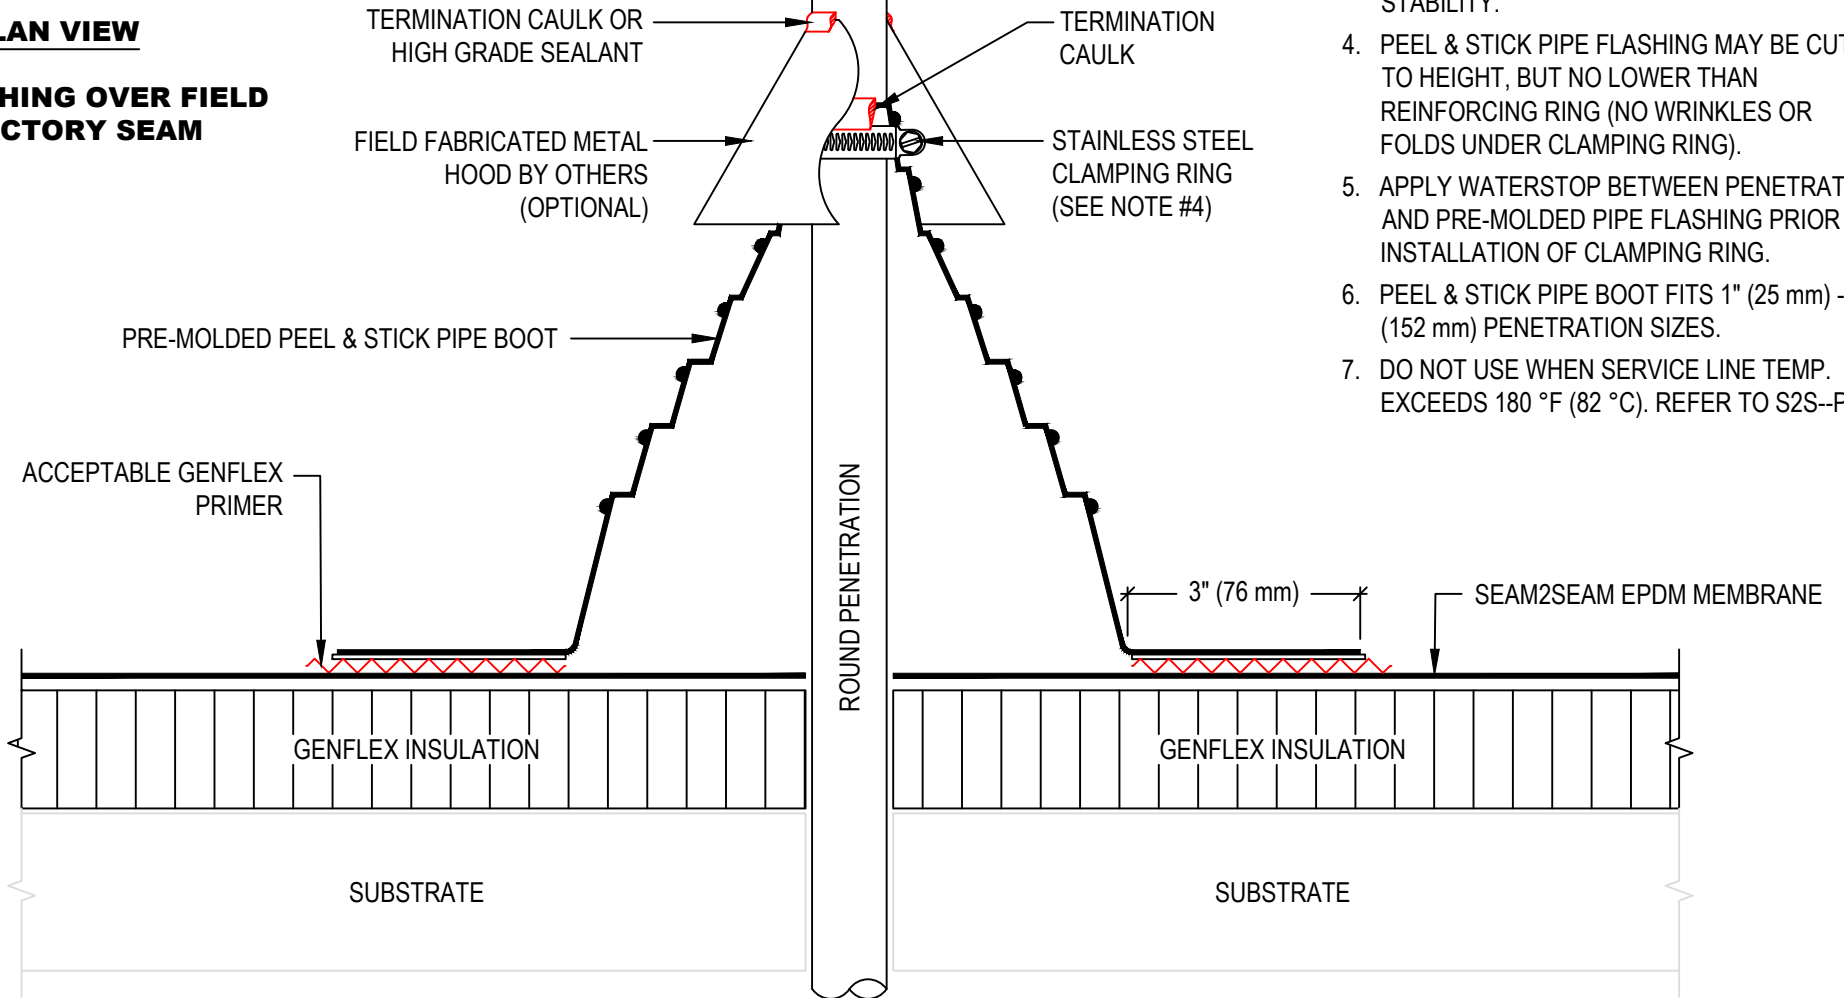

	PENETRATION WITH PEEL & STICK PIPE BOOT		MAXIMUM WARRANTY: 20 Years	
	GENFLEX™	ACCEPTABLE SYSTEMS: SEAM2SEAM™ EPDM	ISSUE / REVISION DATE: 04/06/2020	DETAIL NO. S2S-P-1
GENFLEX: (800) 443-4272 www.genflex.com			NOT TO SCALE	