


GENFLEX REQUIRES 4-1/2" (114.3 mm) TPO T-JOINT COVER OR TPO FLASHING (4" (101.6 mm) x 4" (101.6mm) MIN.) CENTERED OVER INTERSECTION OF SEAM.

**PLAN VIEW**

**PIPE FLASHING OVER SEAM**

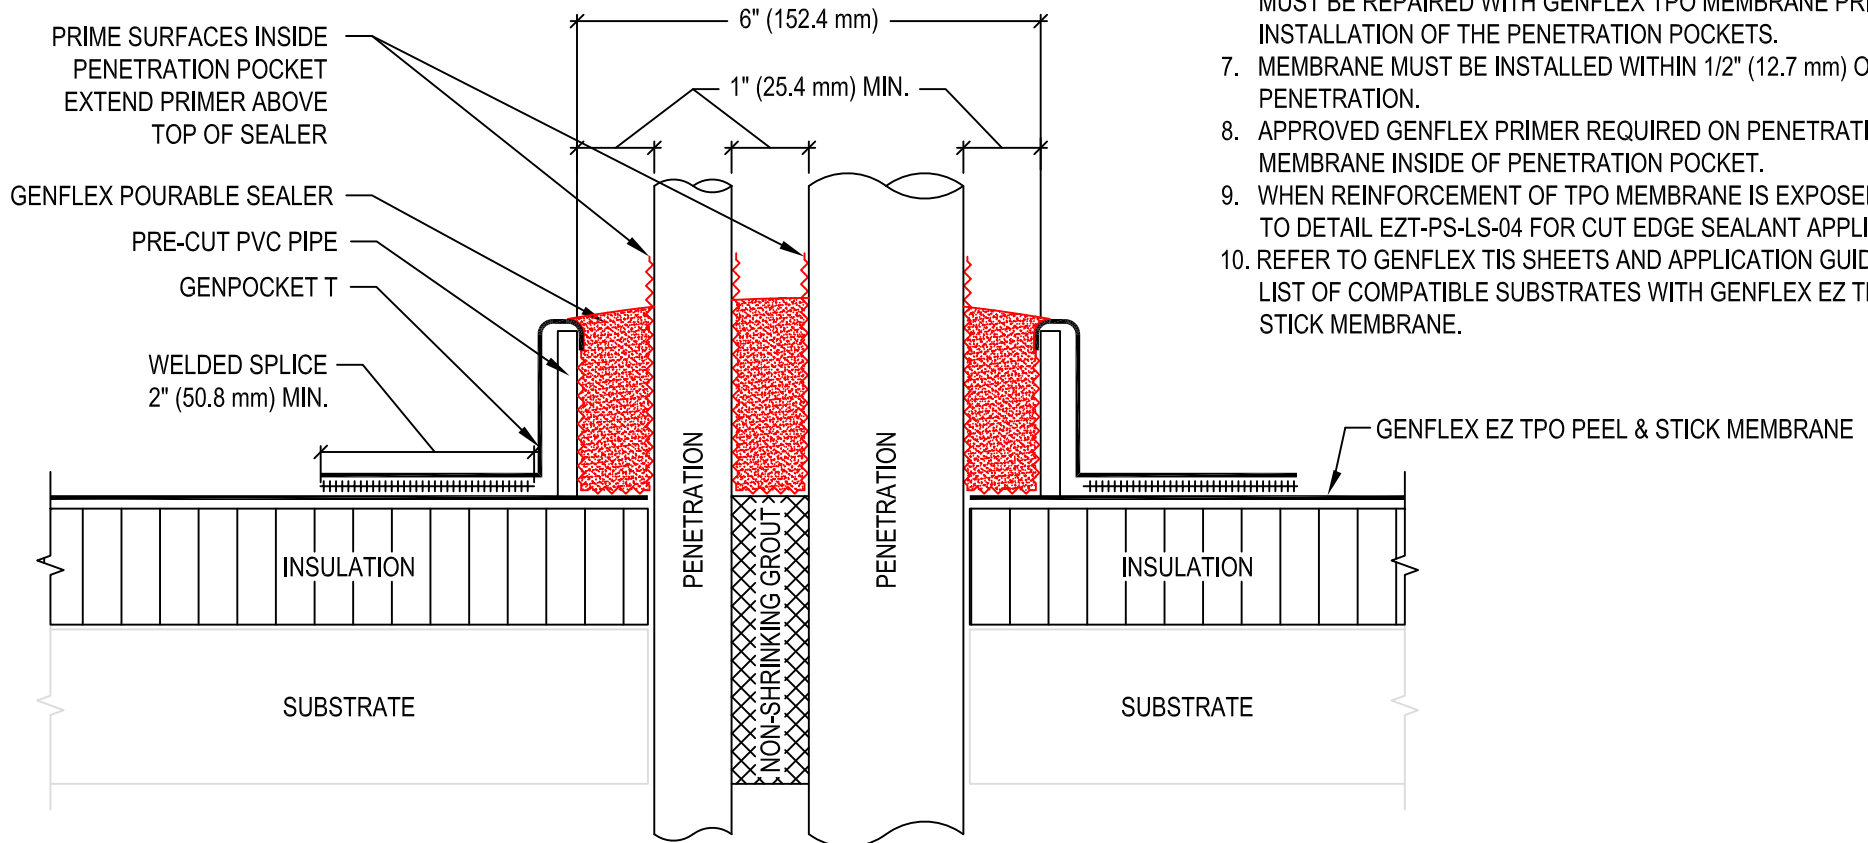

**NOTE:**

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. GENFLEX POURABLE SEALER MOUNTED TO SHED WATER: MIN. DEPTH OF 2" (50.8 mm), REMAINDER OF POCKET MAY BE FILLED WITH A NON-SHRINKING GROUT.
4. DO NOT USE OVER EXISTING PENETRATION POCKETS.
5. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160 °F (71 °C). REFER TO UT-P-06 & UT-P-07.
6. IF FIELD MEMBRANE IS CUT FOR INSULATION, THE MEMBRANE MUST BE REPAIRED WITH GENFLEX TPO MEMBRANE PRIOR TO INSTALLATION OF THE PENETRATION POCKETS.
7. MEMBRANE MUST BE INSTALLED WITHIN 1/2" (12.7 mm) OF PENETRATION.
8. APPROVED GENFLEX PRIMER REQUIRED ON PENETRATIONS AND MEMBRANE INSIDE OF PENETRATION POCKET.
9. WHEN REINFORCEMENT OF TPO MEMBRANE IS EXPOSED, REFER TO DETAIL EZT-PS-LS-04 FOR CUT EDGE SEALANT APPLICATION.
10. REFER TO GENFLEX TIS SHEETS AND APPLICATION GUIDES FOR LIST OF COMPATIBLE SUBSTRATES WITH GENFLEX EZ TPO PEEL & STICK MEMBRANE.



**PENETRATION WITH GENPOCKET T  
PENETRATION POCKET**

MAXIMUM WARRANTY: 20 Years

ACCEPTABLE SYSTEMS: EZ TPO PEEL & STICK™

ACCEPTABLE SYSTEMS: EZ TPO PEEL & STICK™ SELF ADHERED

ISSUE / REVISION DATE:

05/01/2023

DETAIL NO.

**EZT-PS-P-04**

(800) 443-4272 www.genflex.com

NOT TO SCALE