


USE APPROPRIATE TERMINATION

APPROPRIATE PRE-MOLDED TPO INSIDE CORNER HEAT WELDED IN PLACE (SEE NOTE #2 & #6)

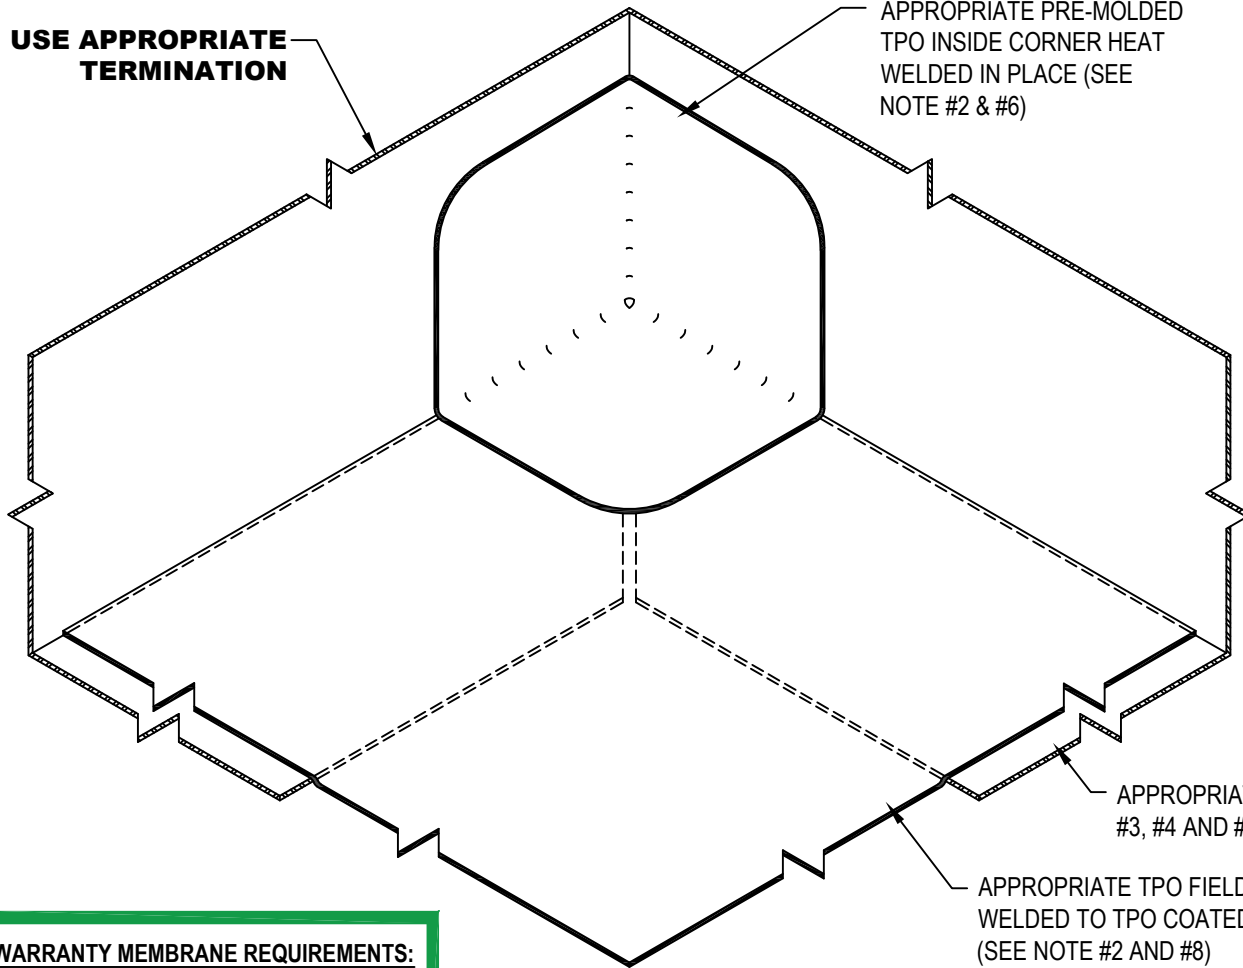

APPROPRIATE TPO COATED METAL (SEE NOTE #3, #4 AND #5)

APPROPRIATE TPO FIELD MEMBRANE HEAT WELDED TO TPO COATED METAL (SEE NOTE #2 AND #8)

NOTE:

1. REFER TO THE GENFLEX™ WEBSITE FOR MOST CURRENT INFORMATION.
2. REFER TO EZT-LS-01 OR EZT-LS-02 FOR WELD WIDTH.
3. INSTALL METAL WORK TO SMACNA RECOMMENDATIONS.
4. FLANGE OF METAL MUST BE FULLY SUPPORTED BY WOOD AND TERMINATED AT LEAST 1/2" (13 mm) FROM EDGE OF OF WOOD.
5. INSTALL APPROPRIATE TPO COATED METAL WITH 1/8" (3.175 mm) TO 1/4" (6.35 mm) MAX. BETWEEN ADJOINING SECTIONS.
6. EZ TPO NON-REFINFORCED FLASHING MAY BE USED IN LIEU OF PRE-MOLDED EZ TPO INSIDE CORNER.
7. **SEE EZT-C-09A FOR DETAILED INSTALLATION INSTRUCTIONS.**
8. WHEN REINFORCEMENT OF TPO MEMBRANE IS EXPOSED, REFER TO EZT-LS-14 FOR CUT EDGE SEALANT APPLICATION.

WARRANTY MEMBRANE REQUIREMENTS:

15-YEAR
TPO - 45 MIL
20-YEAR
TPO - 60 MIL



INSIDE CORNER WITH TPO COATED METAL

MATERIAL: EZ TPO

ACCEPTABLE SYSTEMS: ALL

MAXIMUM WARRANTY: 20 Years

ISSUE / REVISION DATE:

04/16/2026

DETAIL NO.

EZT-C-09

NOT TO SCALE

GENFLEX: (800) 443-4272 www.genflex.com