

WARRANTY MEMBRANE REQUIREMENTS:

15-YEAR


TPO - 45 MIL

20-YEAR

TPO - 60 MIL

NOTE:

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. HOLE IN MEMBRANE SHOULD EXTEND A MINIMUM OF 1/2" (12.7 mm) BEYOND CLAMPING RING AND SHOULD BE LARGER THAN THE DIAMETER OF THE LEADER PIPE.
3. INSULATION ADJACENT TO DRAIN TO BE APPROPRIATE GENFLEX INSULATION WITH APPROPRIATE BONDING SURFACE.
4. MIN 1/2 OF 10 OZ. (295 ml) TUBE OF GENFLEX WATER STOP PER 4" (101.6 mm) DRAIN. USE ADDITIONAL WATER STOP FOR LARGER DRAINS.
5. IN RE-ROOF APPLICATIONS:
 - REMOVE EXISTING FLASHING DOWN TO METAL BOWL.
 - REPAIR OR REPLACE BROKEN DRAINS COMPONENTS.
 - DRILL AND TAP BROKEN DRAINS BOLTS AND REPLACE IF NECESSARY.

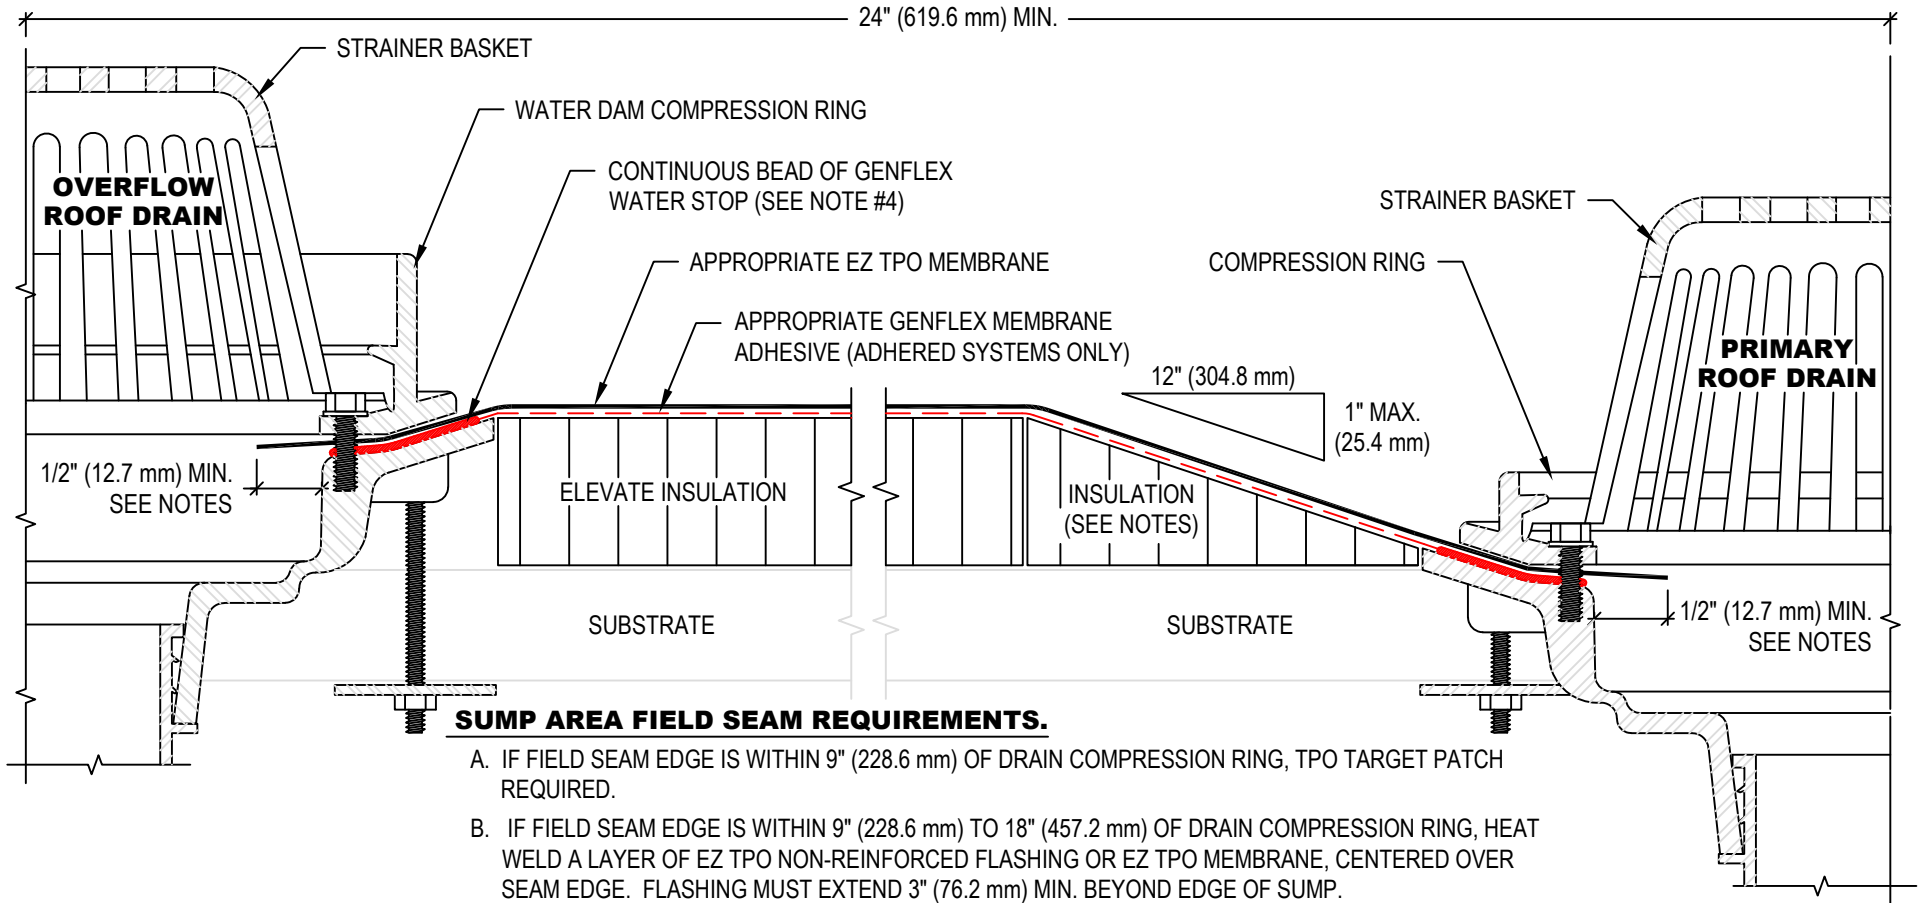

SUMP AREA FIELD SEAM REQUIREMENTS.

- A. IF FIELD SEAM EDGE IS WITHIN 9" (228.6 mm) OF DRAIN COMPRESSION RING, TPO TARGET PATCH REQUIRED.
- B. IF FIELD SEAM EDGE IS WITHIN 9" (228.6 mm) TO 18" (457.2 mm) OF DRAIN COMPRESSION RING, HEAT WELD A LAYER OF EZ TPO NON-REINFORCED FLASHING OR EZ TPO MEMBRANE, CENTERED OVER SEAM EDGE. FLASHING MUST EXTEND 3" (76.2 mm) MIN. BEYOND EDGE OF SUMP.



ROOF DRAIN WITH OVERFLOW ROOF DRAIN

MATERIAL: EZ TPO

ACCEPTABLE SYSTEMS: ALL

GENFLEX: (800) 443-4272 www.genflex.com

MAXIMUM WARRANTY: 20 Years

ISSUE / REVISION DATE:

04/20/2026

NOT TO SCALE

DETAIL NO.

EZT-D-04