


**PLAN VIEW
PIPE FLASHING OVER
FIELD SEAM**

EZ TPO T-JOINT COVER
OR EZ TPO NON-REINFORCED
FLASHING (4" (101.6 mm) x 4"
(101.6 mm) MIN.) CENTERED
OVER INTERSECTION.

WARRANTY MEMBRANE REQUIREMENTS:
15-YEAR
 TPO - 45 MIL
20-YEAR
 TPO - 60 MIL

NOTE:

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
4. PRE-MOLDED PIPE FLASHING MAY BE CUT TO HEIGHT, BUT NO LOWER THAN REINFORCING RING (NO WRINKLES OR FOLDS UNDER CLAMPING RING, FLANGE MUST BE FLAT).
5. APPLY TERMINATION CAULK BETWEEN PENETRATION AND PRE-MOLDED PIPE FLASHING PRIOR TO INSTALLATION OF CLAMPING RING.
6. LARGE PRE-MOLDED PIPE FLASHING FITS 4" (101.6 mm) - 8" (203.2 mm) PENETRATIONS SIZES.
7. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160°F (71.11 °C). REFER TO TPM-P-06 & TPM-P-07.
8. GENFAST FASTENER AND SEAM PLATE REQUIRED FOR MAS ONLY. IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO DETAILS EZT-P-15 & EZT-P-16.
9. PIPE BOOT MUST NOT BE TWISTED, CUPPED OR CUT AND PATCHED FOR INSTALLATION OF PENETRATION.

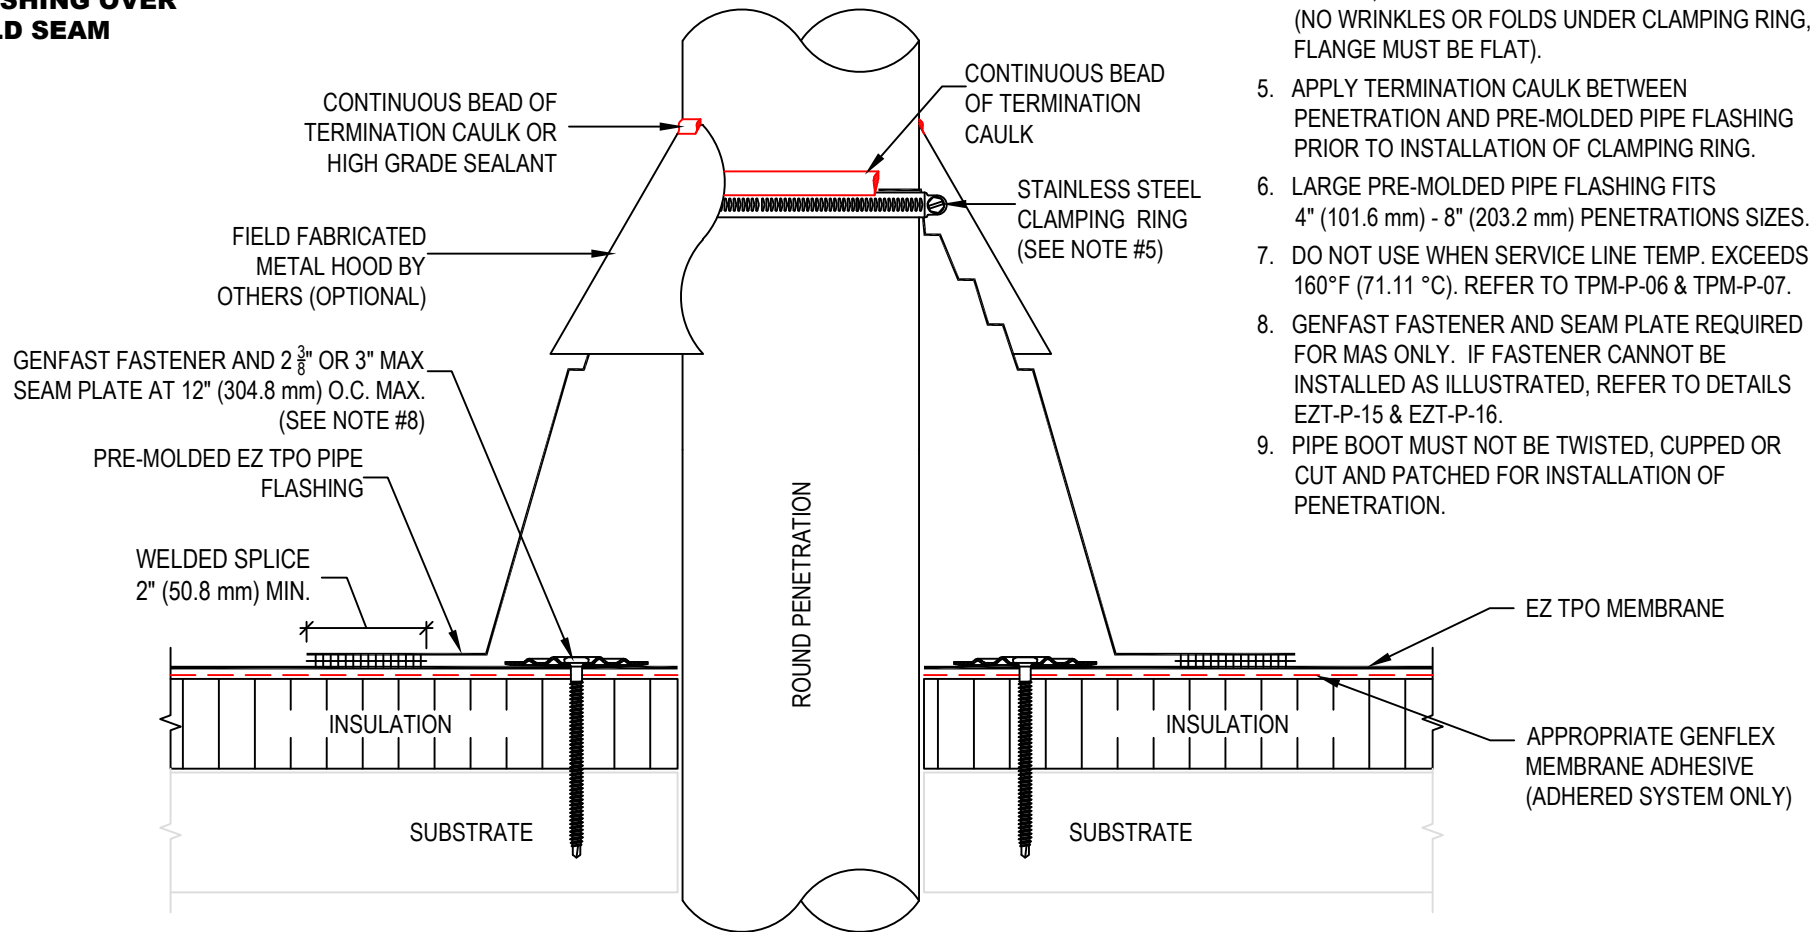

PENETRATION WITH EZ TPO LARGE PIPE FLASHING	
MATERIAL: EZ TPO	ACCEPTABLE SYSTEMS: ALL

MAXIMUM WARRANTY: 20 Years	
ISSUE / REVISION DATE: 12/09/25	DETAIL NO. EZT-P-01
NOT TO SCALE	