


WARRANTY MEMBRANE REQUIREMENTS:

15-YEAR
TPO - 45 MIL
20-YEAR
TPO - 60 MIL

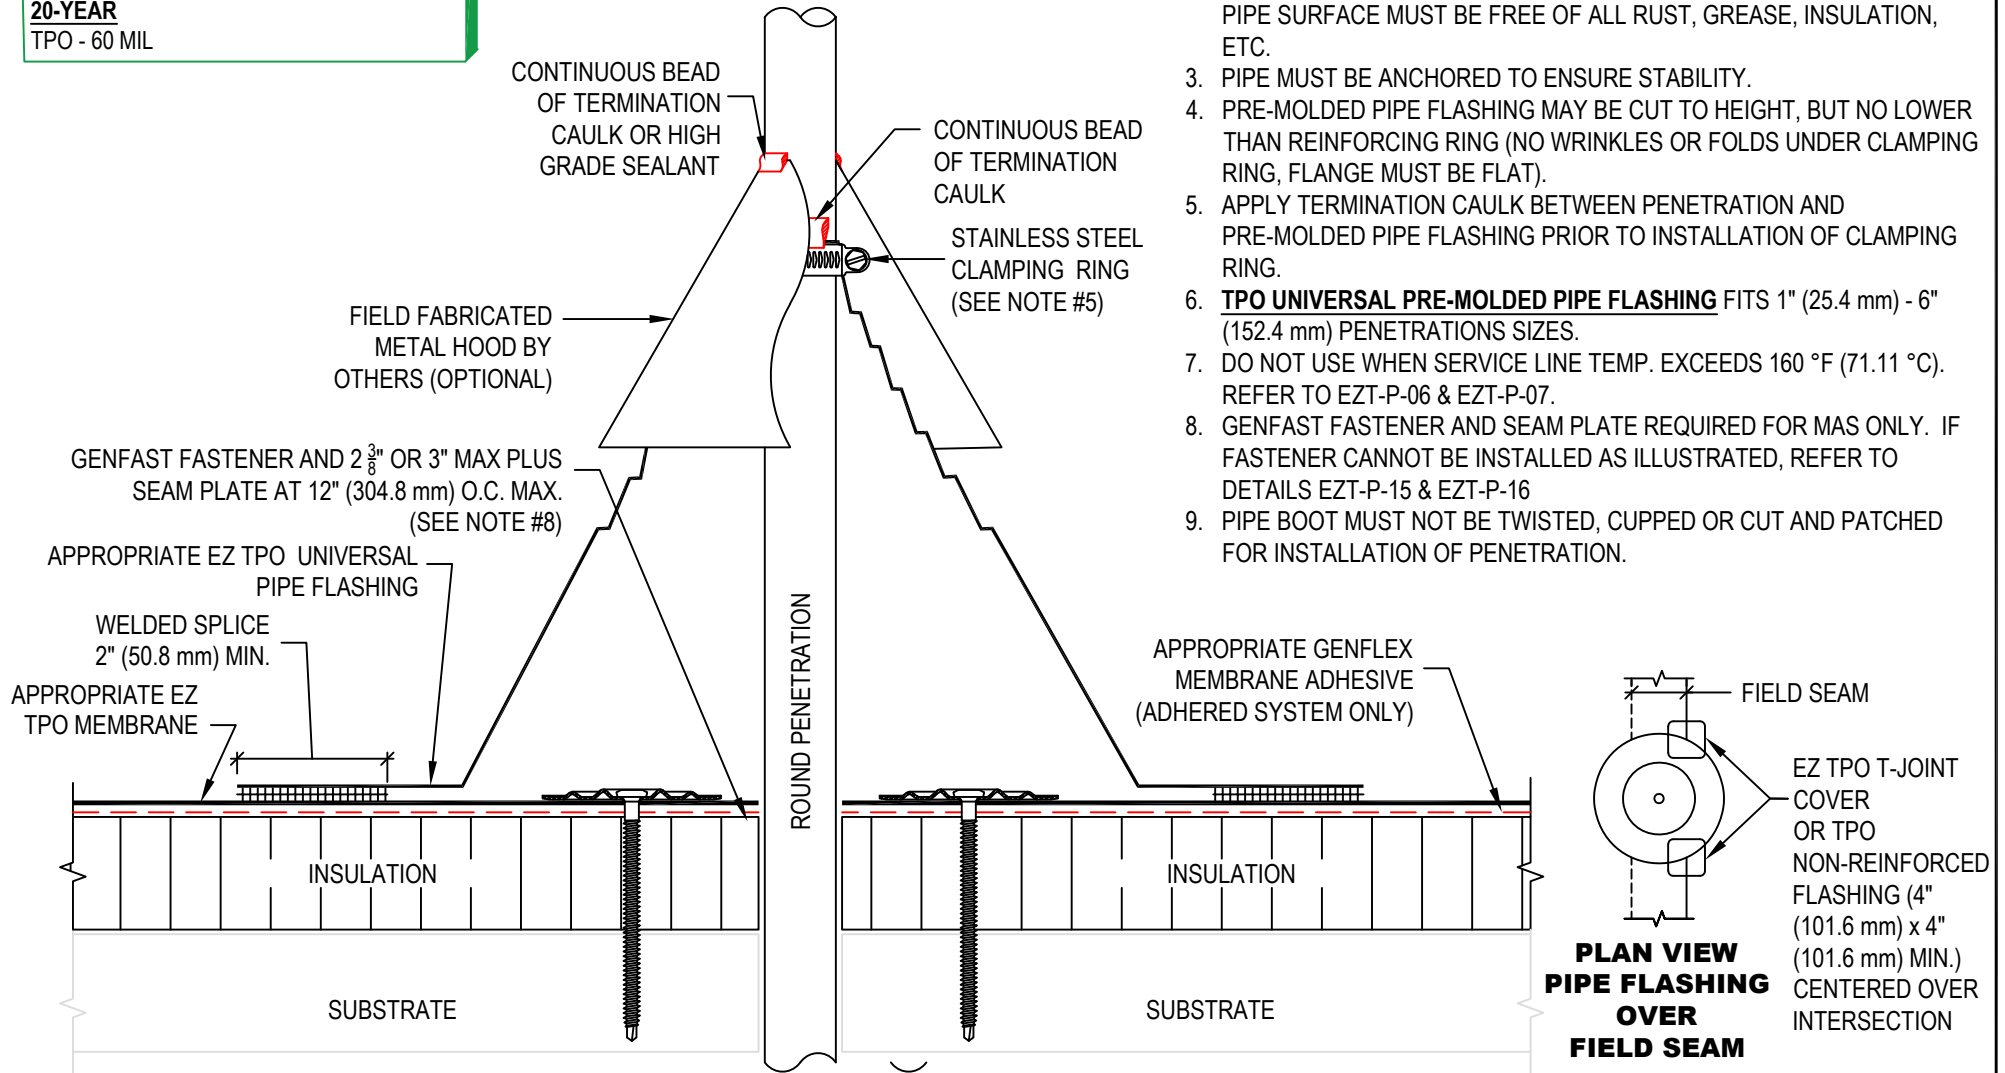

NOTE:

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
4. PRE-MOLDED PIPE FLASHING MAY BE CUT TO HEIGHT, BUT NO LOWER THAN REINFORCING RING (NO WRINKLES OR FOLDS UNDER CLAMPING RING, FLANGE MUST BE FLAT).
5. APPLY TERMINATION CAULK BETWEEN PENETRATION AND PRE-MOLDED PIPE FLASHING PRIOR TO INSTALLATION OF CLAMPING RING.
6. **TPO UNIVERSAL PRE-MOLDED PIPE FLASHING** FITS 1" (25.4 mm) - 6" (152.4 mm) PENETRATIONS SIZES.
7. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160 °F (71.11 °C). REFER TO EZT-P-06 & EZT-P-07.
8. GENFAST FASTENER AND SEAM PLATE REQUIRED FOR MAS ONLY. IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO DETAILS EZT-P-15 & EZT-P-16
9. PIPE BOOT MUST NOT BE TWISTED, CUPPED OR CUT AND PATCHED FOR INSTALLATION OF PENETRATION.



PENETRATION WITH EZ TPO UNIVERSAL PIPE FLASHING (SMALL)

MATERIAL: EZ TPO

ACCEPTABLE SYSTEMS: ALL

MAXIMUM WARRANTY: 20 Years

ISSUE / REVISION DATE:
04/20/2026

DETAIL NO.
EZT-P-02

GENFLEX: (800) 443-4272 www.genflex.com

NOT TO SCALE