


**WARRANTY MEMBRANE REQUIREMENTS:**

**15-YEAR**

TPO - 45 MIL

**20-YEAR**

TPO - 60 MIL

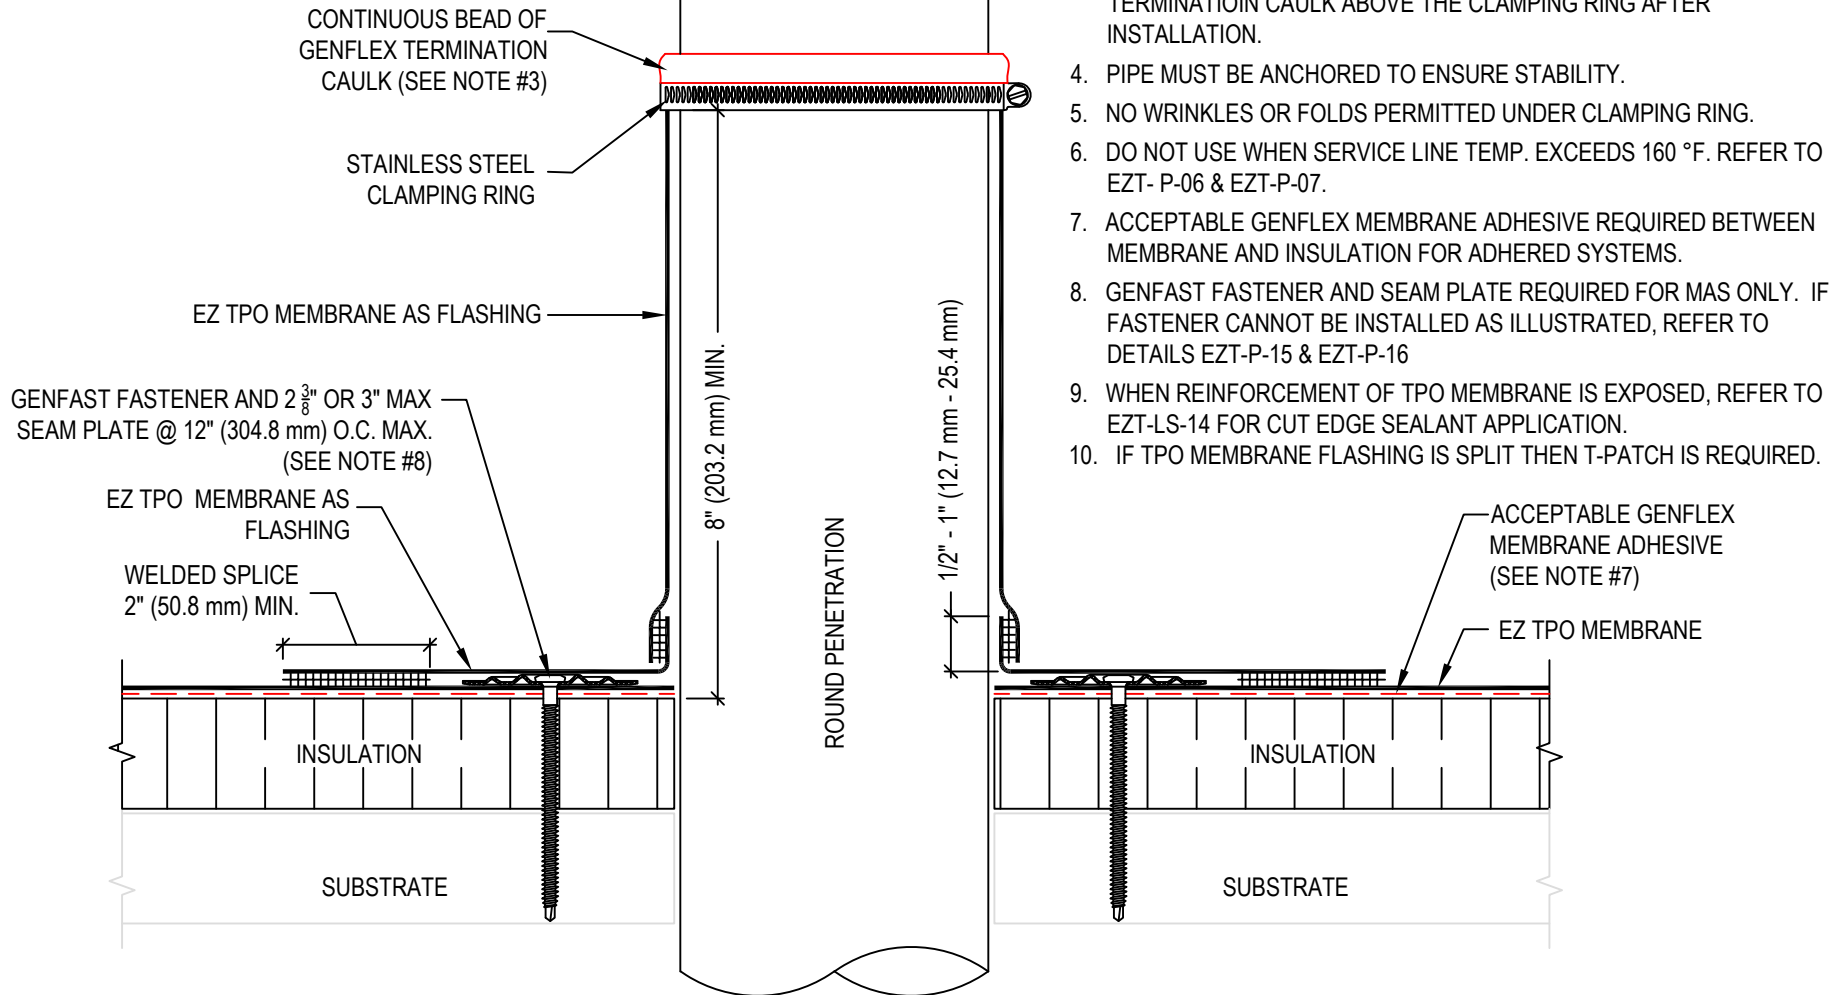

**NOTE:**

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. APPLY TERMINATION CAULK BETWEEN THE PENETRATION AND PIPE FLASHING PRIOR TO INSTALLING THE CLAMPING RING. APPLY TERMINATION CAULK ABOVE THE CLAMPING RING AFTER INSTALLATION.
4. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
5. NO WRINKLES OR FOLDS PERMITTED UNDER CLAMPING RING.
6. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160 °F. REFER TO EZT- P-06 & EZT-P-07.
7. ACCEPTABLE GENFLEX MEMBRANE ADHESIVE REQUIRED BETWEEN MEMBRANE AND INSULATION FOR ADHERED SYSTEMS.
8. GENFAST FASTENER AND SEAM PLATE REQUIRED FOR MAS ONLY. IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO DETAILS EZT-P-15 & EZT-P-16
9. WHEN REINFORCEMENT OF TPO MEMBRANE IS EXPOSED, REFER TO EZT-LS-14 FOR CUT EDGE SEALANT APPLICATION.
10. IF TPO MEMBRANE FLASHING IS SPLIT THEN T-PATCH IS REQUIRED.



**PENETRATION WITH EZ TPO MEMBRANE (FIELD FABRICATED)**

MATERIAL: EZ TPO

ACCEPTABLE SYSTEMS: ALL

MAXIMUM WARRANTY: 20 Years

ISSUE / REVISION DATE:

04/20/2026

DETAIL NO.

**EZT-P-05**

NOT TO SCALE

GENFLEX: (800) 443-4272 www.genflex.com