


**WARRANTY MEMBRANE REQUIREMENTS:**

**15-YEAR**

TPO - 45 MIL

**20-YEAR**

TPO - 60 MIL

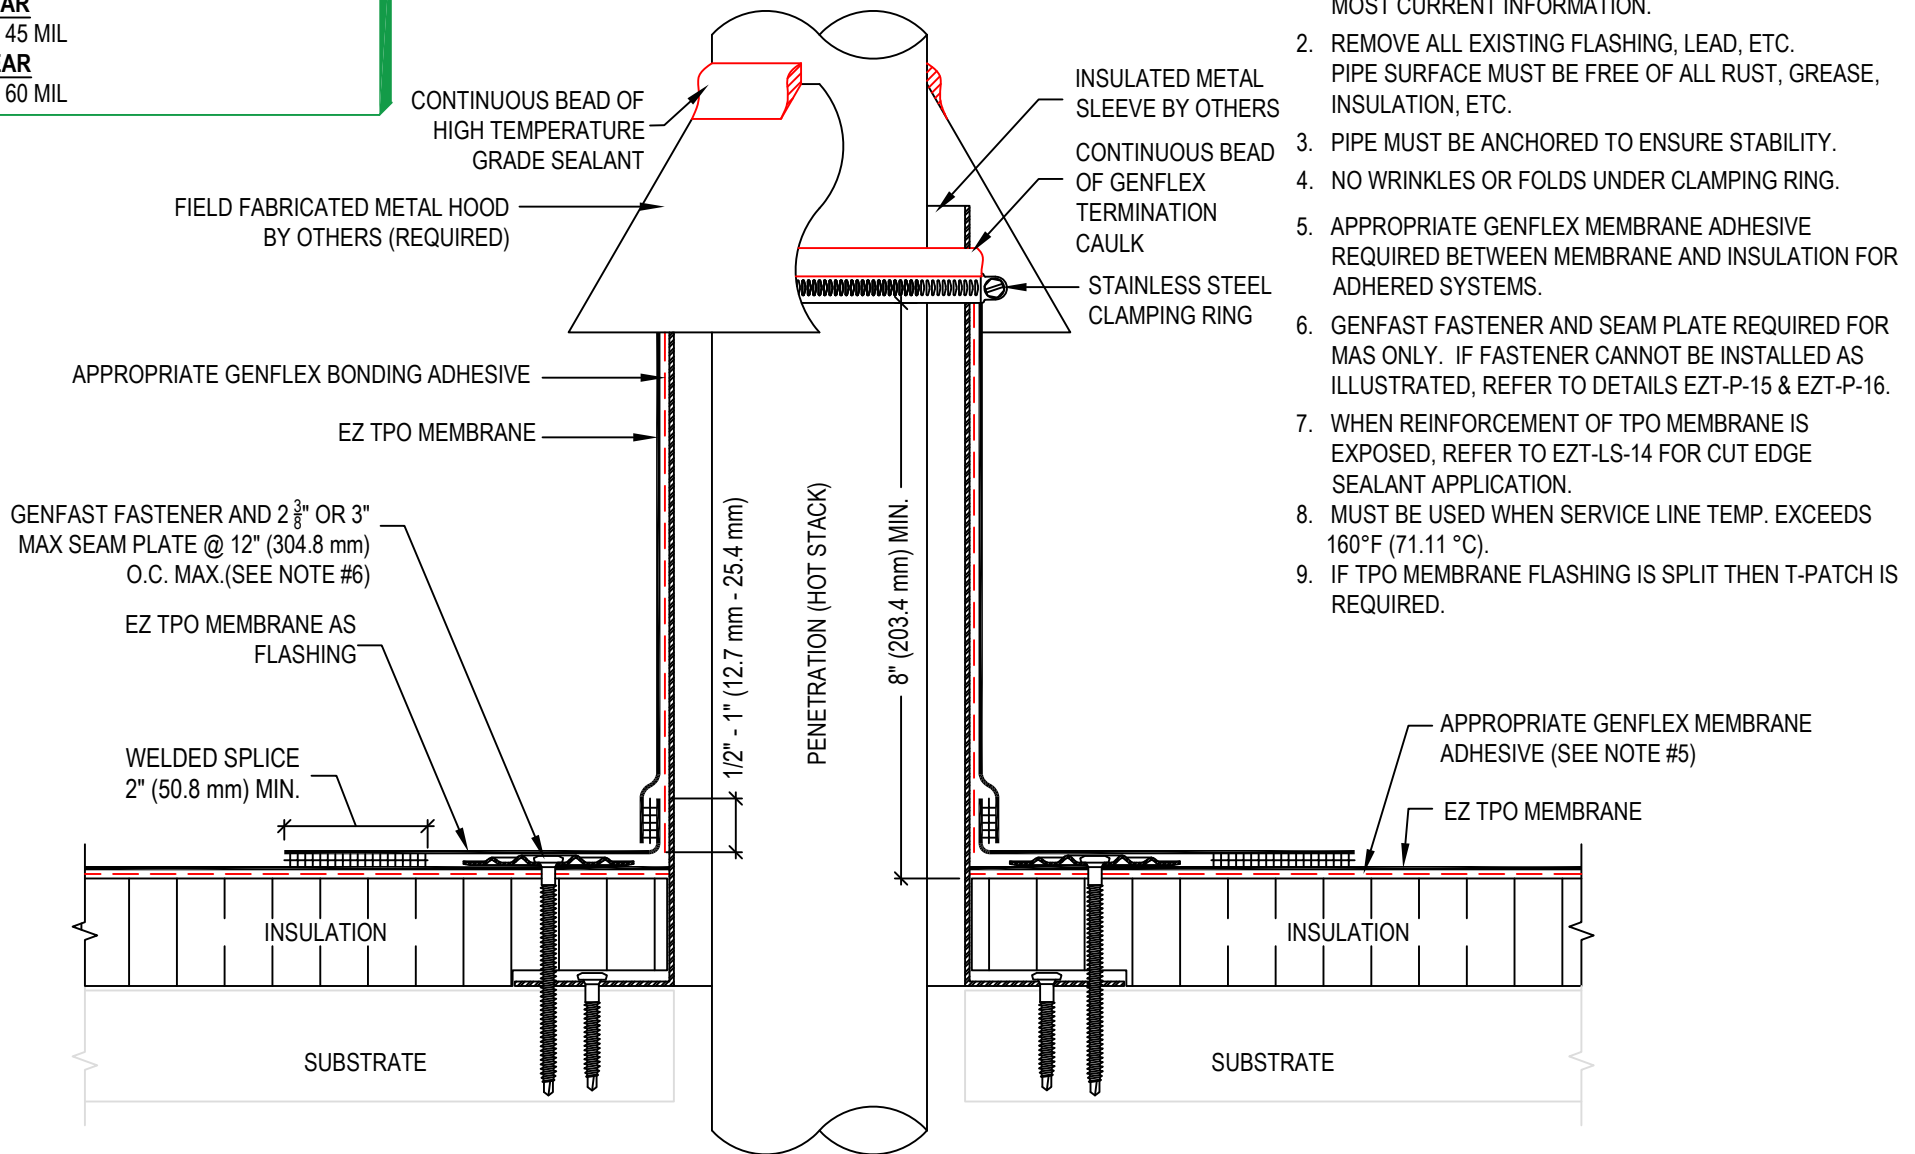

**NOTE:**

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
4. NO WRINKLES OR FOLDS UNDER CLAMPING RING.
5. APPROPRIATE GENFLEX MEMBRANE ADHESIVE REQUIRED BETWEEN MEMBRANE AND INSULATION FOR ADHERED SYSTEMS.
6. GENFAST FASTENER AND SEAM PLATE REQUIRED FOR MAS ONLY. IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO DETAILS EZT-P-15 & EZT-P-16.
7. WHEN REINFORCEMENT OF TPO MEMBRANE IS EXPOSED, REFER TO EZT-LS-14 FOR CUT EDGE SEALANT APPLICATION.
8. MUST BE USED WHEN SERVICE LINE TEMP. EXCEEDS 160°F (71.11 °C).
9. IF TPO MEMBRANE FLASHING IS SPLIT THEN T-PATCH IS REQUIRED.



**PENETRATION (HOT STACK) WITH THERMOPLASTIC MEMBRANE**

MATERIAL: EZ TPO

ACCEPTABLE SYSTEMS: ALL

MAXIMUM WARRANTY: 20 Years

ISSUE / REVISION DATE:

04/20/2026

DETAIL NO.

**EZT-P-07**

NOT TO SCALE