


**NOTE:**

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. GENFLEX POURABLE SEALER MOUNDED TO SHED WATER (MINIMUM DEPTH OF 2" (50.8 mm), REMAINDER OF POCKET MAY BE FILLED WITH A NON-SHRINKING GROUT.
4. DO NOT USE OVER EXISTING PENETRATION POCKETS.
5. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160°F (71.11 °C). REFER TO EZT-P-06 & EZT-P-07.
6. IF FIELD MEMBRANE IS CUT FOR INSULATION, THE MEMBRANE MUST BE REPAIRED WITH TPO MEMBRANE PRIOR TO INSTALLATION OF THE PENETRATION POCKET.
7. MEMBRANE MUST BE INSTALLED WITHIN 1/2" (12.7 mm) OF PENETRATION.
8. PRIME PENETRATIONS AND INSIDE OF POCKET BEFORE INSTALLING SEALER..
9. REFER TO EZT-P-15 OR EZT-P-16 FOR MAS.

**WARRANTY MEMBRANE REQUIREMENTS:**  
**15-YEAR**  
 TPO - 45 MIL  
**20-YEAR**  
 TPO - 60 MIL

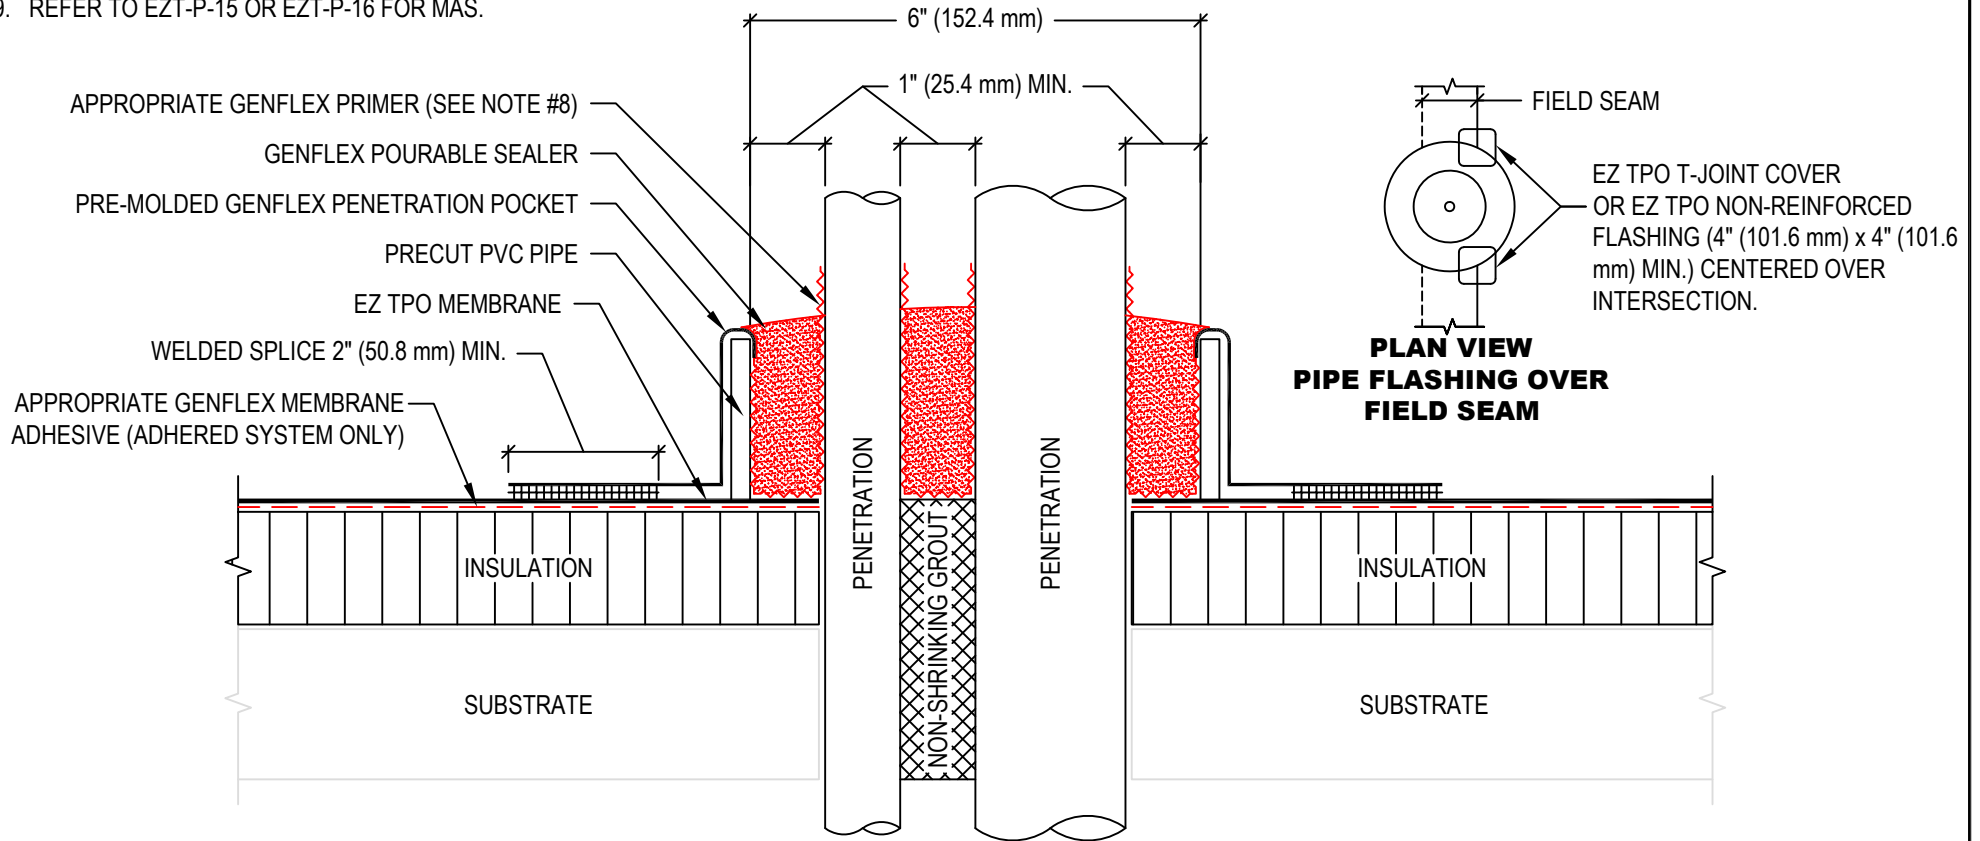

	<b>PENETRATION WITH TPO PENETRATION POCKET KIT</b>		MAXIMUM WARRANTY: 20 Years	
	MATERIAL: EZ TPO	ACCEPTABLE SYSTEMS: ALL	ISSUE / REVISION DATE: 04/20/2026	DETAIL NO. <b>EZT-P-08</b>
GENFLEX: (800) 443-4272 www.genflex.com			NOT TO SCALE	