


NOTE:

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. HOLE IN MEMBRANE SHOULD EXTEND A MINIMUM OF 1/2" (13 mm) BEYOND CLAMPING RING AND SHOULD NOT BE SMALLER THAN THE DIAMETER OF THE LEADER PIPE.
3. INSULATION ADJACENT TO DRAIN TO BE APPROPRIATE GENFLEX INSULATION WITH APPROPRIATE BONDING SURFACE.
4. GENFLEX WATER STOP MIN 1/2 OF 10 OZ. (295 ml) TUBE PER 4" DRAIN. USE ADDITIONAL WATER STOP FOR LARGER DRAINS.
5. IN RE-ROOF APPLICATIONS:
 - REMOVE EXISTING FLASHING DOWN TO METAL BOWL.
 - REPAIR OR REPLACE BROKEN DRAINS COMPONENTS.
 - DRILL AND TAP BROKEN DRAINS BOLTS AND REPLACE IF NECESSARY.
6. REFER TO DETAIL EZT-FB-LS-01 OR EZT-FB-LS-03 FOR WELD WIDTH.
7. APPROVED EZ FLEECE BACK TPO MEMBRANE ADHESIVE ATTACHMENT METHOD REQUIRED BETWEEN MEMBRANE AND INSULATION FOR ADHERED FB SYSTEMS.

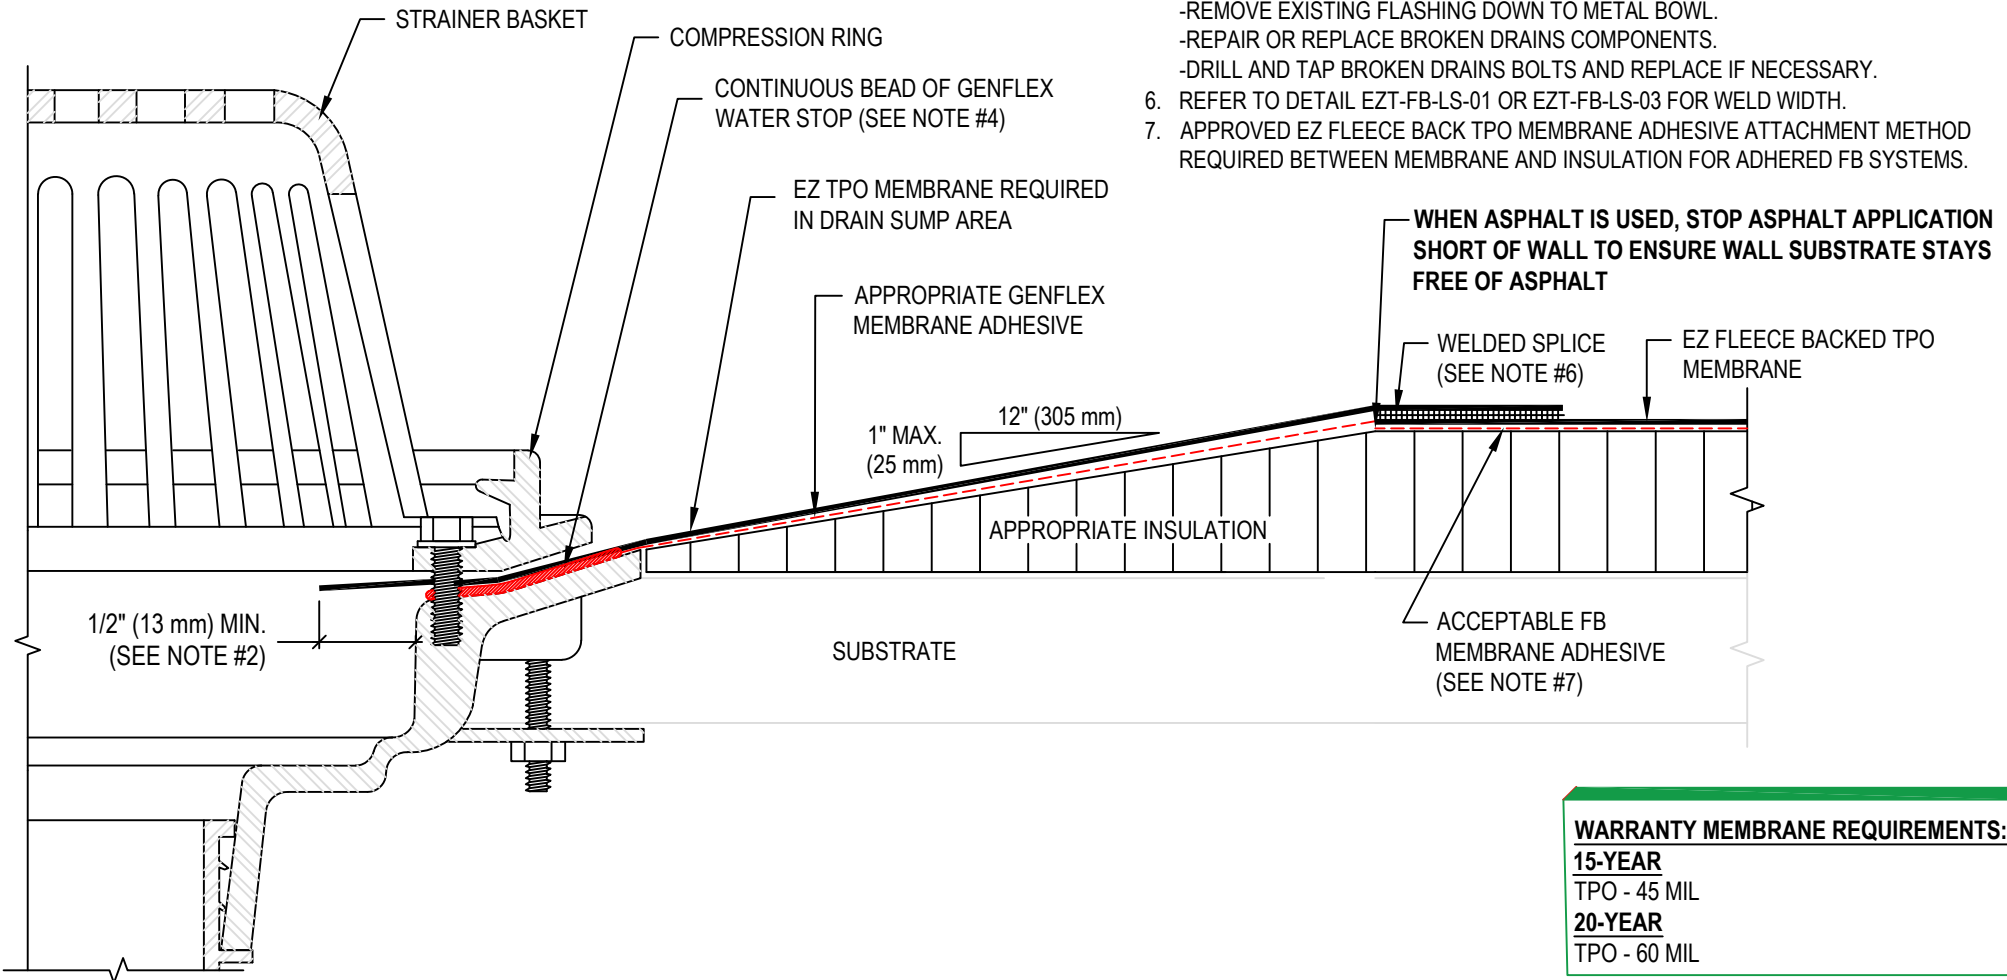

WARRANTY MEMBRANE REQUIREMENTS:
15-YEAR
 TPO - 45 MIL
20-YEAR
 TPO - 60 MIL

	ROOF DRAIN (TARGET PATCH REQUIRED) EZ FLEECE BACKED TPO ADHERED SYSTEM		MAXIMUM WARRANTY: 20 Years	
	MATERIAL: EZ FLEECE BACKED TPO	ACCEPTABLE SYSTEMS: ALL	ISSUE / REVISION DATE: 04/20/2026	DETAIL NO. EZT-FB-D-01
GENFLEX: (800) 443-4272 www.genflex.com			NOT TO SCALE	