

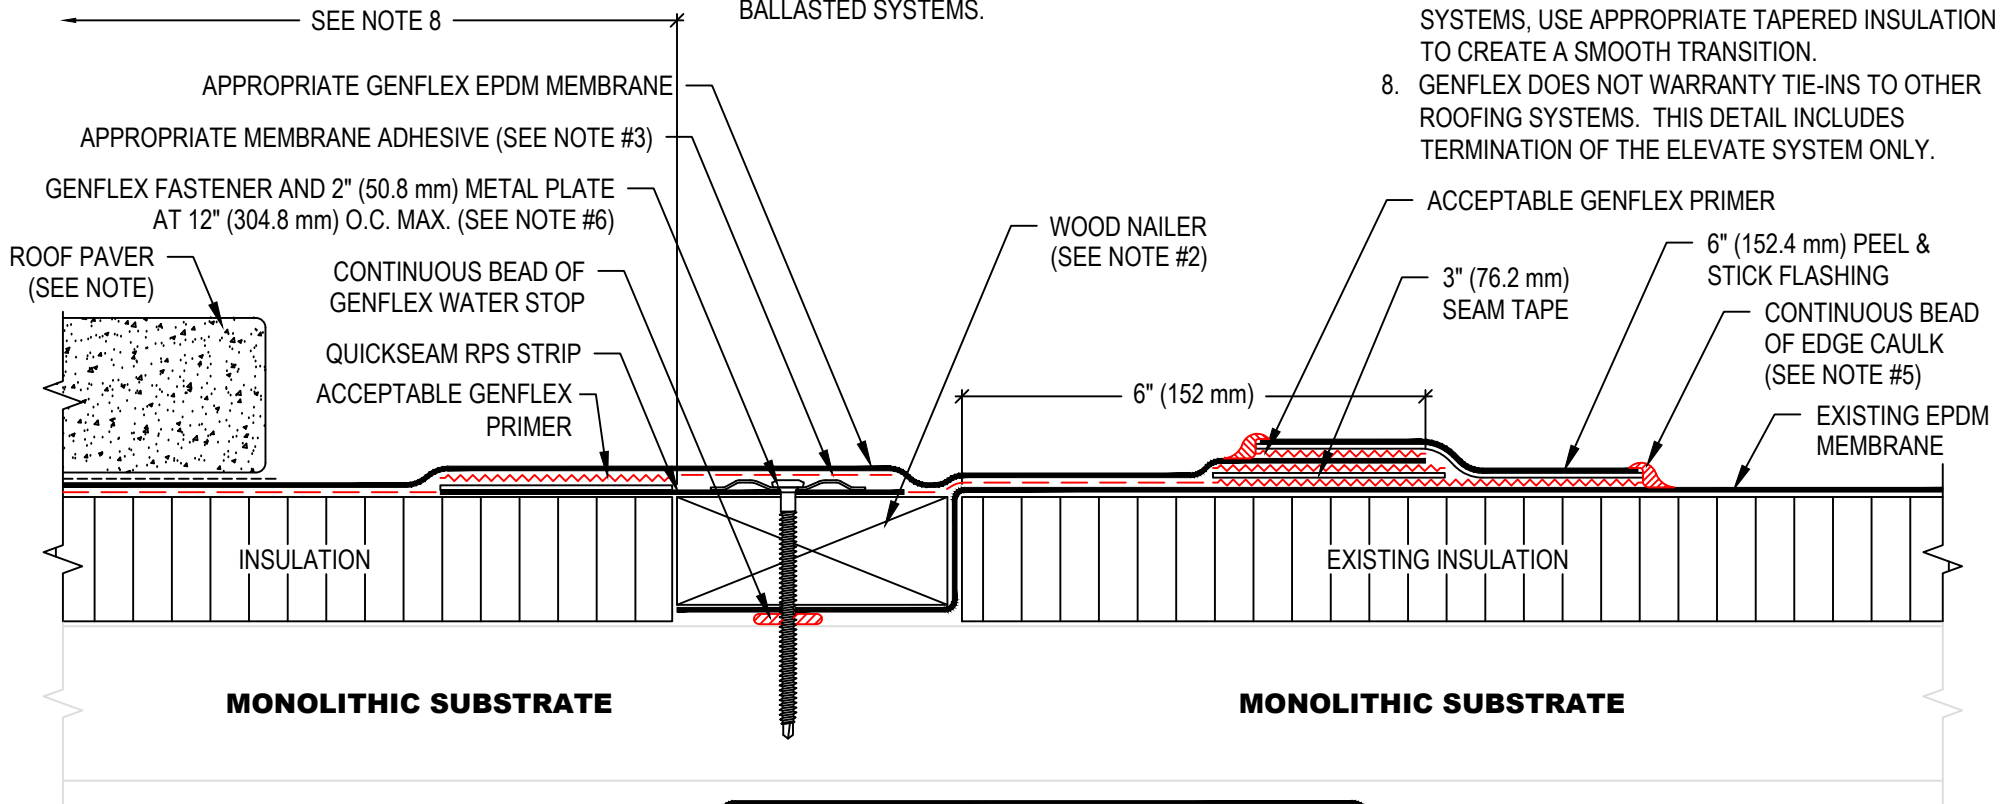
WARRANTY MEMBRANE REQUIREMENTS:

UP TO 15-YEAR: 45 mil

UP TO 20-YEAR: 60 mil

NOTE:

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. WOOD NAILER MUST BE INSTALLED TO MEET APPLICABLE BUILDING CODES.
3. APPROPRIATE GENFLEX MEMBRANE ADHESIVE REQUIRED BETWEEN MEMBRANE AND INSULATION FOR ADHERED SYSTEMS.
4. GENFLEX ROOF PAVER (MIN.10 lb (4.5KG) PER SQ. FT.) INSTALLED OVER PROTECTION LAYER REQUIRED FOR BALLASTED SYSTEMS.
5. APPLY EDGE CAULK AROUND ENTIRE PERIMETER OF FLASHING. REFER TO LS-09 FOR SEAM EDGE TREATMENT.
6. BATTEN STRIP MAY BE USED IN LIEU OF 2" (50.8 mm) METAL PLATES FOR MAS AND ADHERED SYSTEMS ONLY. REFER TO "BT" DETAILS FOR SPECIFIC BASE TIE-IN INFORMATION, REQUIREMENTS, AND OPTIONS. METAL BATTEN REQUIRED FOR 20-25 YEAR WARRANTIES.
7. WHEN CHANGE IN ELEVATION OCCURS BETWEEN SYSTEMS, USE APPROPRIATE TAPERED INSULATION TO CREATE A SMOOTH TRANSITION.
8. GENFLEX DOES NOT WARRANTY TIE-INS TO OTHER ROOFING SYSTEMS. THIS DETAIL INCLUDES TERMINATION OF THE ELEVATE SYSTEM ONLY.

**TIE-IN TO EXISTING ROOF SYSTEM NOT
WARRANTED BY GENFLEX****TIE-IN EPDM SYSTEM TO EXISTING EPDM SYSTEM
(MONOLITHIC SUBSTRATE)**

MATERIAL: EPDM

ACCEPTABLE SYSTEMS: ALL

MAXIMUM WARRANTY: SEE TABLE

ISSUE / REVISION
DATE:

05/01/2026

DETAIL NO.

BT-18

NOT TO SCALE

GENFLEX: (800) 443-4272 www.genflex.com