




DETAIL A-1
SURFACE MOUNTED COUNTER-FLASHING
ACCEPTABLE WOOD SUBSTRATE

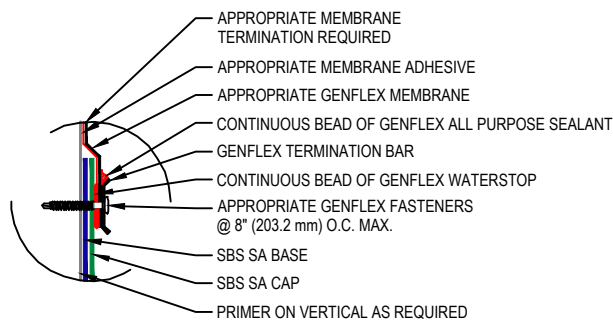

DETAIL A-2
WALL FLASHING WITH SINGLE-PLY

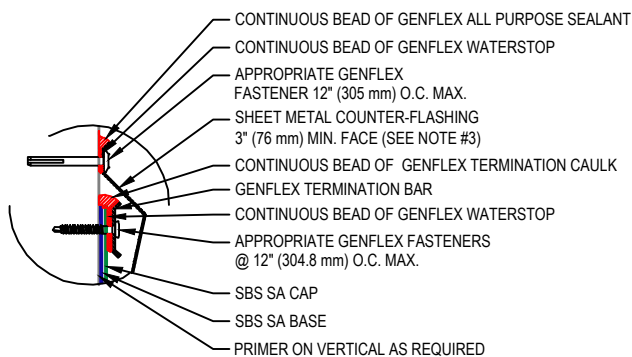

DETAIL A-3
SURFACE MOUNTED COUNTER-FLASHING
WITH TERMINATION BAR

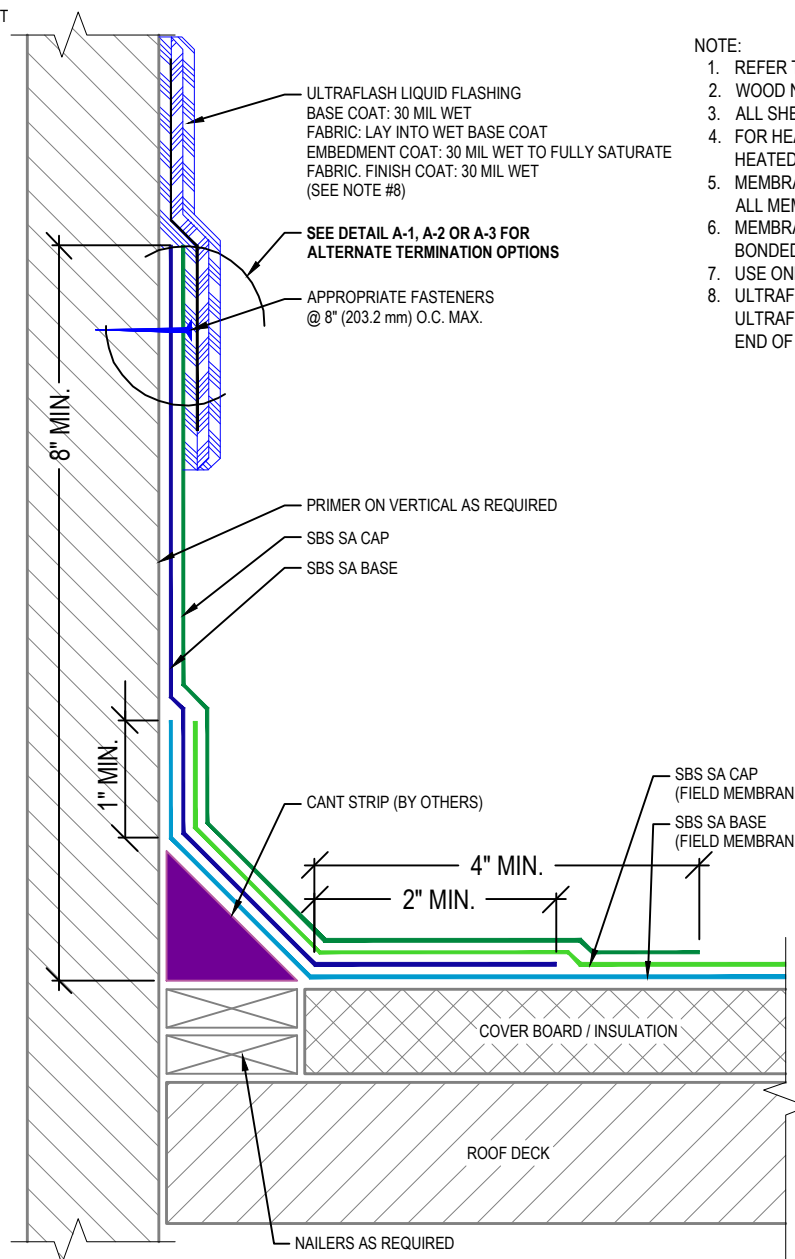

NOTE:

1. REFER TO THE GENFLEX™ WEBSITE FOR THE MOST CURRENT INFORMATION.
2. WOOD NAILERS MUST BE INSTALLED TO MEET APPLICABLE BUILDING CODES.
3. ALL SHEET METAL IS TO BE INSTALLED PER SMACNA GUIDELINES.
4. FOR HEAT FUSED MEMBRANE APPLICATIONS, SET METAL FLASHING ONTO HEATED SOFTENED MEMBRANE.
5. MEMBRANE END LAPS ARE TO BE A MINIMUM 6" (152.4 mm) AND ADHERED AT ALL MEMBRANE TO MEMBRANE SEAMS.
6. MEMBRANE LAPS AT FLANGED METAL TO BE 3" (76.2 mm) MINIMUM AND FULLY BONDED TO PRIMED METAL SURFACE.
7. USE ONLY WHEN ROOF DECK IS SUPPORTED BY THE WALL.
8. ULTRAFLASH WHEN USED MUST EXTEND 2" (50.8 mm) PAST EDGE OF FABRIC. ULTRAFLASH FLASHING SYSTEM SHALL EXTEND A MIN. OF 3" (76.2 mm) PAST END OF MEMBRANE ON ALL SIDES.



VERTICAL TERMINATION FLASHING
SBS SA APPLICATION

GENFLEX

ACCEPTABLE SYSTEMS: **SBS SELF-ADHERED**

GENFLEX: (800) 443-4272 www.genflex.com

MAXIMUM WARRANTY: 20 Years

ISSUE / REVISION
DATE:

06/10/2026

NOT TO SCALE

DETAIL NO.

MBSA-BT-2